

DT Quattro COM2-24

Presence Detectors



The DT Quattro COM2-24 Dual Technology Presence Detector utilizes PIR and ultrasonic technologies to detect the presence or signature of a person in a space. The logic options for initial “ON” and “Maintained” state of occupancy gives design engineers and installation contractors the choice for proper control of lighting and HVAC in difficult applications where detection options are needed in a single device. Lighting loads are controlled in relation to both presence detection and selectable ambient light levels with the integrated force off photocell to maximize energy savings. The separate HVAC dry contact output is signaled only by presence detection and has a separate “ON/OFF” delay time feature set. STEINEL’s world class PIR optics and ultrasonic signal processing provides unparalleled line of sight and volumetric presence detection. Operational choices of auto on or manual on with a momentary or maintained switch input. The convenient “COM-Link” feature enables multiple sensors to link together via the communication link for pier to pier grouping achieving expanded detection zones with control set up functions set at only one primary sensor for the entire group. The available service and user wireless remotes provide simplified commissioning and occupant convenience.

The Control PRO group of presence detectors are available in multiple presence detection technologies for the control of heating, ventilation and air-conditioning (HVAC) and lighting loads (as in the COM2-24 versions) and optional 1-10 volt dimming and daylighting options (in the DIM-24 versions).

Applications

The typical application is for lighting and HVAC in classrooms, conference rooms, computer rooms, storage rooms, workspaces, open office space with cubicles, general open areas, restrooms, stairwells, storage rooms, executive offices and private offices.

Project Name:

Location:



DT Quattro COM2-24

| | |
|--|--|
| Item No. | 64710 DT Quattro COM2-24 |
| Accessories | 65300 RC 3 service remote 65320 RC 4 user remote 65330 WGC wire guard cage |
| Voltage | 18-24 VDC/VAC (34 mA) 50/60 Hz |
| Load Rating | control output - 1 A @ 30 VAC/VDC HVAC dry contacts - 1 A @ 30 VAC/VDC |
| Sensing Technology | passive infrared (PIR), single pyro, 11 detection levels, 520 switching zones, ultrasonic 40 kHz |
| Time Delay Setting | control output - 30 sec. - 30 min. pulse mode (approx. 2 sec. 'ON' 8 sec. 'OFF') IQ mode (automatic adjustment to the usage profile) HVAC dry contacts: 0 sec. - 10 min. switch 'ON' delay 1 min. - 2 hrs. stay 'ON' time, auto-HVAC mode |
| Light Level Setting | 10 - 1000 lux / 1 - 100 fc |
| Environment | IP20 rated, 0° C to +40° C / 32° F to 104° F |
| Ultrasonic Detection Zones: (Coverage at 2.5 m / 9 ft) | presence: max. of 6 x 6 m (36 sq.m.) max. of 20 x 20 ft (400 sq.ft.) min. of 2 x 2 (4 sq.m.) min. of 6.5 x 6.5 ft (42.25 sq.ft.) radial / tangential: max. of up to 10 x 10 m (100 sq.m.) radial / tangential: max. of up to 32 x 32 ft (1000 sq.ft.) |
| PIR Detection Zones: | presence: max. of 3 x 3 m (9 sq.m.) max. of 10 x 10 ft (100 sq.ft.) radially: max. of 4 x 4 m (13 x 13 ft) tangentially: max. of 8 x 8 m (26 x 26 ft) |
| Dimensions | 4.72 x 4.72 x 2.68 in, 120 x 120 x 68 mm (LxWxD) |
| Warranty | 5 years |
| Certifications | C-UL-US Listed, RoHS compliant UL 2043 Plenum Rated, CA Energy Code compliant |

Key Features:

- Low voltage (18-24 VDC/VAC) sensor for use with a power pack or building automation system
- Independent ON and OFF time settings for the HVAC (NO/NC)
- PIR & Ultrasonic (40 kHz) Presence Detection
- Service and user wireless remotes available
- Manual ON mode (MAN) / Automatic mode (AUTO)
- Momentary / Maintained switch option
- 'ON' only / 'ON' & 'OFF' manual switching
- Light level feature turns lights off with sufficient daylight
- IQ Mode dynamically adjusts the 'ON' time delay by learning individual room occupancy
- Auto-HVAC mode



Passive Infrared
Ultrasonic



20 x 20 Ft Presence
32 x 32 Ft Max



1 - 100 fc



18 - 24 VDC/VAC & HVAC



30 Sec - 30 Min




www.steinell.net

DT Quattro COM2-24

Presence Detectors




Wiring

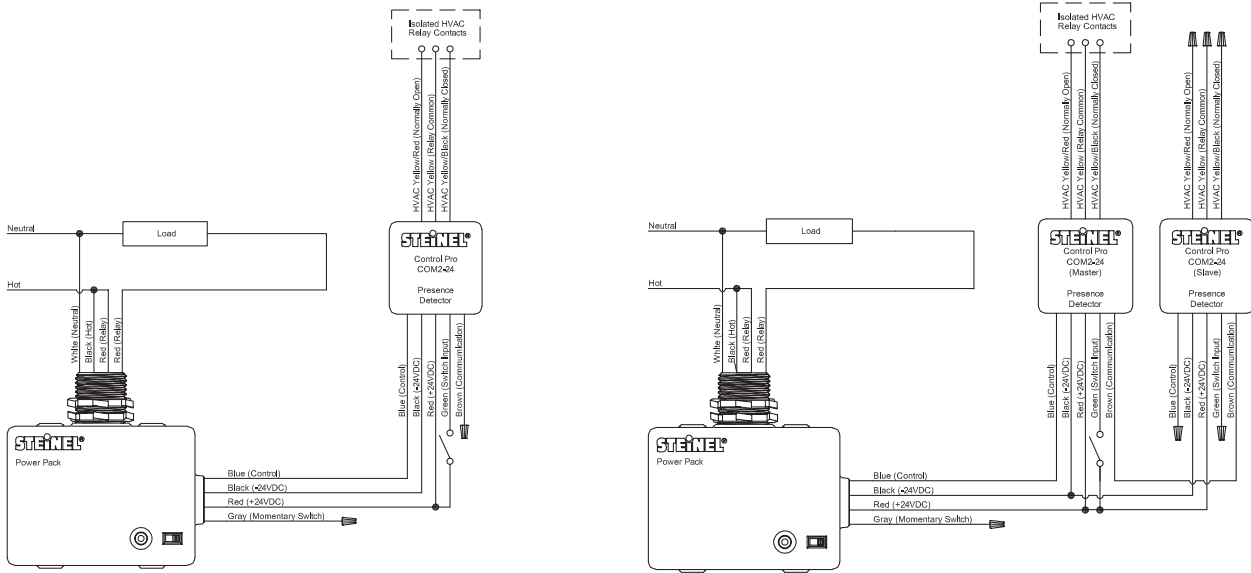

Settings


- 1 - Light level setting
- 2 - Occupancy time delay setting
- 3 - Reach setting
- 4 - HVAC stay-'ON' time
- 5 - HVAC switch-'ON' delay
- 6 - Sensor DIP switch settings
- 7 - Trigger mode
- DIP 1 - Normal mode / Test mode (NORM / TEST)
- DIP 2 - Manual ON mode (MAN) / Automatic mode (AUTO)
- DIP 3 - Momentary / Maintained switch option
- DIP 4 - 'ON' only / 'ON' & 'OFF' manual switching
- DIP 5 - Not used
- DIP 6/7/8 - Trigger mode

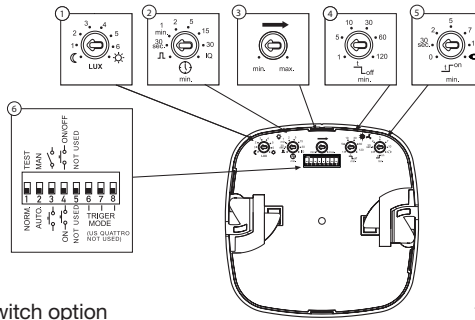

Coverage

Shown coverage diagram at 9 ft mounting height. Ultrasonic signal can be increased by hard surfaces and decreased by soft surfaces.


One Gridline = 1 m / 3.3 ft

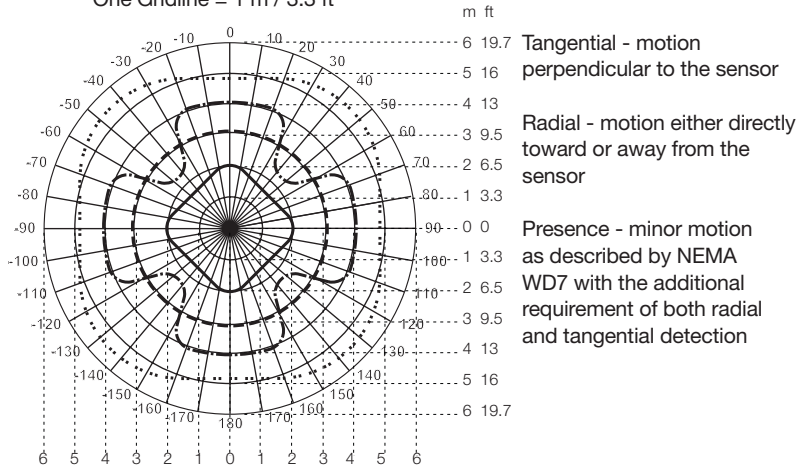


| Trigger Mode Options | Initial Occupancy | Maintain Occupancy | DIP 6 | DIP 7 | DIP 8 |
|--------------------------|-------------------|--------------------|-------|-------|-------|
| Option 1 | Both | Either | ↓ OFF | ↓ OFF | ↓ OFF |
| Option 2 | Both | Both | ↓ OFF | ↓ OFF | ↑ ON |
| Option 3 | PIR | Either | ↓ OFF | ↑ ON | ↓ OFF |
| Option 4 | US | Either | ↓ OFF | ↑ ON | ↑ ON |
| Option 5 Factory Setting | Either | Either | ↑ ON | ↓ OFF | ↓ OFF |
| Option 6 | US | US | ↑ ON | ↓ OFF | ↑ ON |
| Option 7 | PIR | PIR | ↑ ON | ↑ ON | ↓ OFF |
| Option 8 | Either | Both | ↑ ON | ↑ ON | ↓ OFF |

The trigger mode enables the user to choose which sensing technologies should be used to initially turn the load on and which technologies are required to keep it on.

Mounting

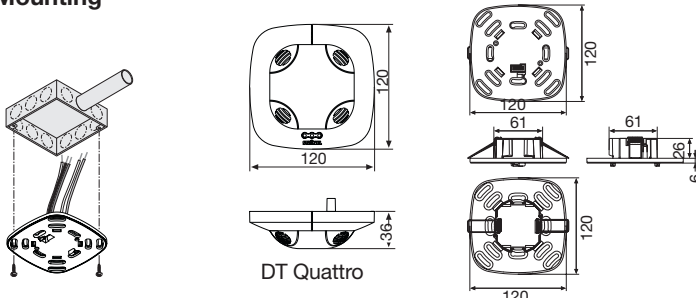

Mounts to a 4" Square box, 4" Octagon box or Round 3.0 Mud-Ring

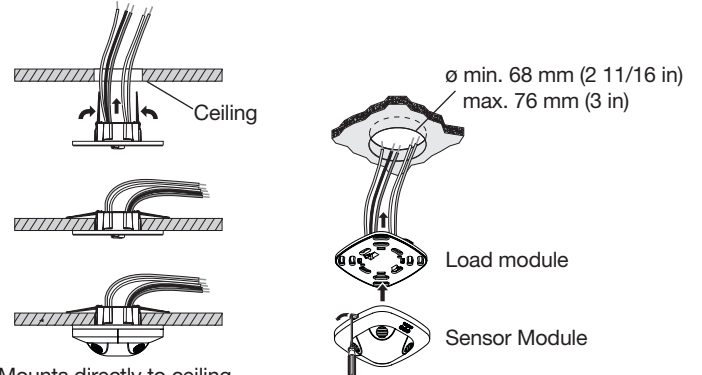

Mounts directly to ceiling with quick mount spring tabs